


NOTES

1. 5' MINIMUM BURY FOR ALL MAINS AND SERVICES.
2. ALL LINES MUST BE APPROVED BY HLD PRIOR TO COVER.
3. TIE ON TAPE SHALL BE USED AT ALL THREADED CONNECTIONS.
4. ALL MATERIALS SHALL BE NSF 61 APPROVED. NO OR LOW LEAD FITTINGS SHALL BE USED WHERE APPLICABLE.
5. ALL MATERIALS SHALL BE TIGHTENED TO MANUFACTURERS TORQUE SPECIFICATIONS.
6. ALL INSTALLATION SHALL BE TRUE, STRAIGHT, PLUMB AND CENTERED.


ITEM NO. AND DESCRIPTION

- 1 WATER MAIN PER HLD APPROVED PLANS AND IDAHO STANDARDS FOR PUBLIC WORKS CONSTRUCTION.
- 2 *SIZE OF MAIN* X 1.5" OR 2" DOUBLE STRAP SADDLE.
- 3 LINE TAP-
a. WET TAP- 2" X 2" OR 3" MIP X 3" POLYETHYLENE PACK JOINT FITTING WITH INTERIOR STIFFENER.
b. WET TAP- 3" MIP CORPORATION STOP X 2" POLYETHYLENE PACK JOINT FITTING WITH INTERIOR STIFFENER.
- 4 2" 250 PSI POLYETHYLENE METER LATERAL.
- 5 10 GAUGE SOLID COPPER TRACER WIRE. SPLICE TO TRACE WIRE ON MAIN USING 3M TYPE DBR OR DRYCONN DBSR SPLICE KIT. RUN TRACE WIRE TO NORTH OR WEST METER ONLY.
- 6 1" X 1" X 2" BRASS OR STAINLESS STEEL TEE WITH CLOSE NIPPLE CONNECTED TO 1.5" OR 2" POLYETHYLENE PACK JOINT FITTING WITH INTERIOR STIFFENER.
- 7 1" X 18" BRASS OR STAINLESS STEEL
- 8 1" BALL CURB STOP- A.Y. McDONALD, FORD OR HLD APPROVED EQUIVALENT.
a. CURB BOX TO BE 4" SDR 35 PVC STACK; INSTALLED PLUMB AND EXTENDED ABOVE GROUND WITH CAP. AFTER FINAL INSPECTION AND PRESSURE TEST FINISH CURB STACK TO GRADE. CAP WITH 4" VALVE STACK WITH TYLER FOUNDING TOP SECTION AND LID SET TO FINISH GRADE.
- 9 1" X 12.24" POLY PIPE
- 10 A.Y. McDONALD'S 795 SERIES TOP ADJUSTABLE COIL METER PIT OR EQUIVALENT METER COIL PIT AS APPROVED BY HLD.
- 11 1" X 3/4" A.Y. McDONALD, FORD OR HLD APPROVED EQUIVALENT NO OR LOW LEAD METER ADAPTORS, METER INSTALLED BY HLD.
- 12 PAC JOINT.
- 13 CUSTOMER SERVICE LATERAL. INSTALL PER PLUMBING CODE. STUB PAST DRY UTILITY EASEMENT. TERMINATE WITH 1" PVC THREADED CAP INSTALLED HAND TIGHT.
- 14 2" X 4" MARKER PAINTED BLUE. EXTEND 12" ABOVE SIDEWALK GRADE.

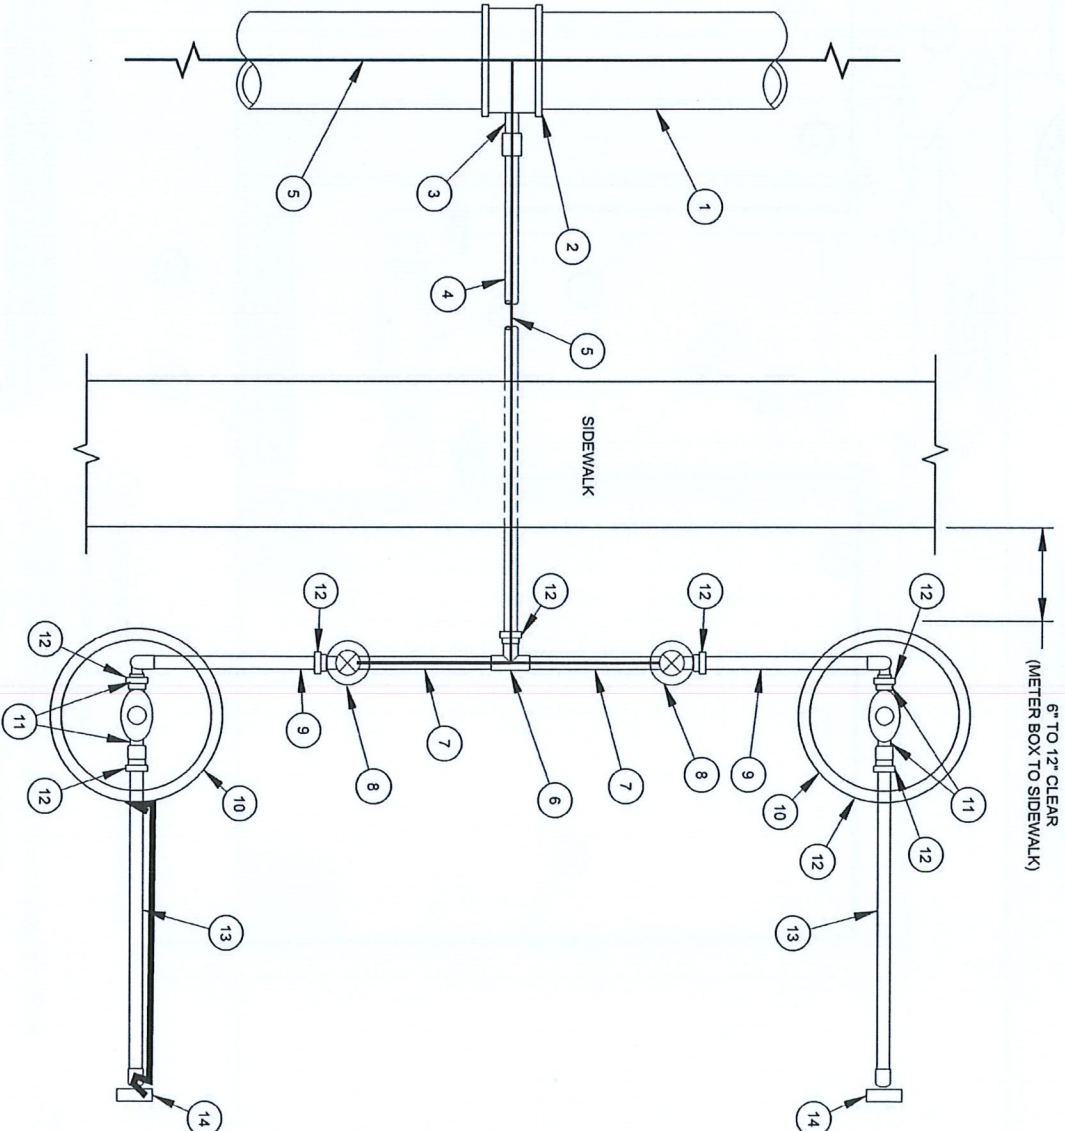

DATE	DESCRIPTION

REVISIONS



**HAYDEN LAKE
IRRIGATION DISTRICT**

DUAL RESIDENTIAL METER SET PLAN VIEW

HLD DETAIL #:
003A

SCALE: NONE
DATE: April, 2020
DWG: 003A - DUAL_SET(11-2019).dwg
APPROVED: BR