


**ITEM NO. AND DESCRIPTION:**


- 1. ULTRASONIC METER.
- 2. STRAINER.
- 3. GATE VALVE.
- 4. DRAIN ROCK: TOPPED WITH 4" OF 3/4 CRUSHED.
- 5. 5x7' CONCRETE VAULT WITH BILCO STYLE TYPE "K" ALUMINUM DOOR.
- 6. UNION COUPLER.
- 7. ROMAC DJ400 DISMANTLING JOINT.
- 8. 2" BYPASS OCTIVE METER.

**NOTES:**

- 1. SUPPORT METER AND PIPE WITH APPROVED PIPE SUPPORT STANDS AND PROVIDE 12" CLEARANCE FROM THE FLOOR.
- 2. BILCO STYLE TYPE "K" ALUMINUM DOOR.
- 3. OPEN BOTTOM WITH DRAIN ROCK.
- 4. MEET HLID STANDARDS OR ISPWC STANDARDS FOR ALL COMPONENTS. IN THE CASE OF CONFLICT, THE MOST STRINGENT WILL APPLY.
- 5. COORDINATE INSIDE DIMENSIONS OF STRUCTURE TO ALLOW FOR PIPING LAYOUT AS SHOWN AND DETERMINE THE ACTUAL LENGTHS OF DUCTILE IRON.
- 6. CENTERLINE OF PIPING SHALL BE 36" ABOVE FLOOR GRADE.

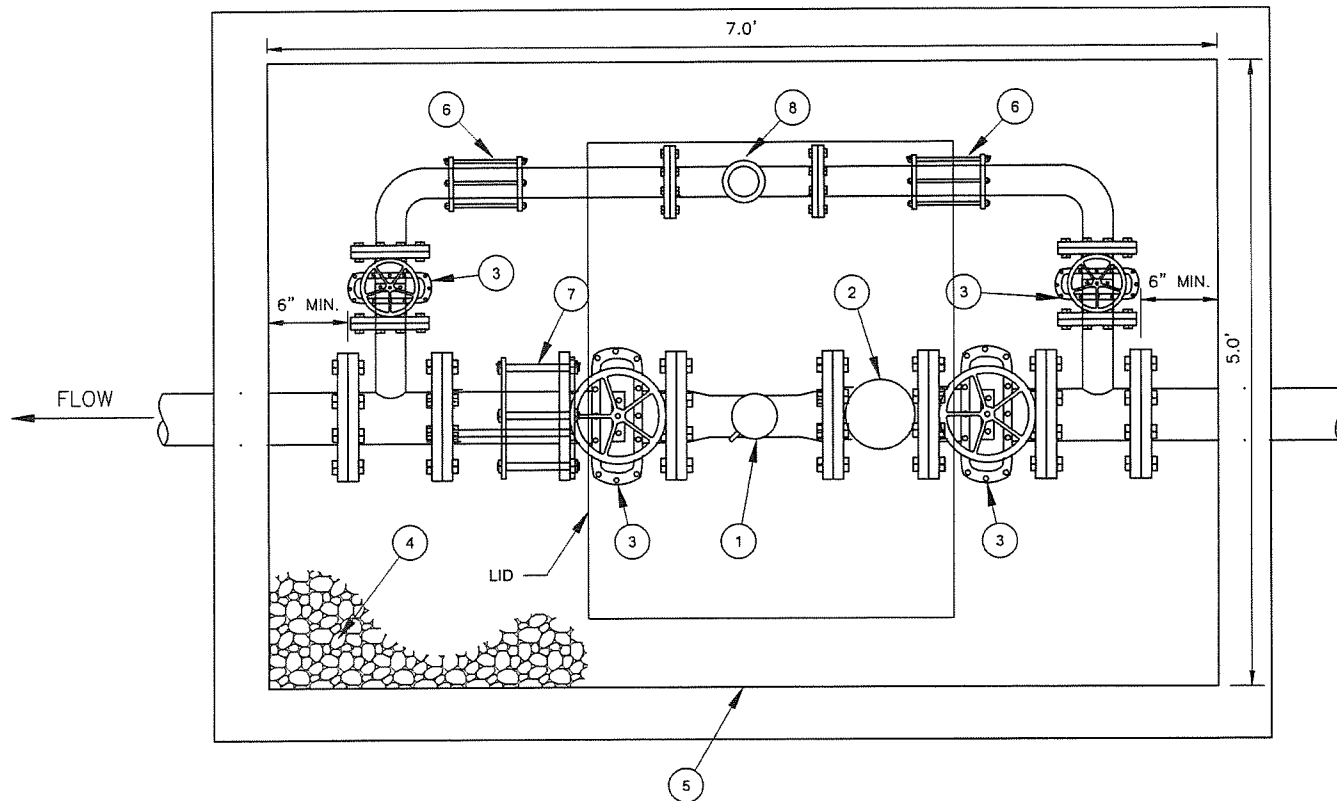

REVISIONS	
DATE	DESCRIPTION



<b>HAYDEN LAKE IRRIGATION DISTRICT</b>	
<b>TYPICAL 3" AND LARGER METER SET</b>	
HLID DETAIL #: <b>008</b>	
SCALE: NONE	DATE: July, 2022
DWG: 008 - 3IN_AND_LARGER_METER_SET(11-2019).dwg	APPROVED: BR