



**KEYED NOTES:**

- 1 HEATED INSULATED SHELTER; INTERIOR DIMENSIONS 70"x26"x45" MIN OR AS REQUIRED TO FIT PIPING, SEE ELECTRICAL.
- 2 WALKINS, FEBCO MODEL 860U 2" RPBA ASSEMBLY, OR APPROVED EQUIVALENT.
- 3 SLAB ON GRADE; SIZE AND THICKNESS AS SHOWN, #4 AT 12" O.C. EACH WAY.
- 4 SLOPE SLAB 1/4" PER FOOT TO ENCLOSURE DRAIN PORTS.
- 5 2-INCH PVC PIPE SLEEVE.
- 6 SECURE PER MANUFACTURER'S RECOMMENDATIONS.
- 7 TEE WITH 3/4" NPT, WITH CAP
- 8 5' MINIMUM BETWEEN STOP AND WASTE VALVE BOX AND HLID METER.
- 9 STOP AND WASTE VALVE. ONE CUBIC FOOT OF DRAIN ROCK BELOW.
- 10 4" SDR 3034 VERTICAL PIPE WITH TYLER UNION VALVE BOX AND WATER LID.
- 11 5' SEPARATION FROM HLID METER.
- 12 DRAIN ROCK.
- 13 CAUTION UNDERGROUND WATERMAIN MARKER IN "BLUE".

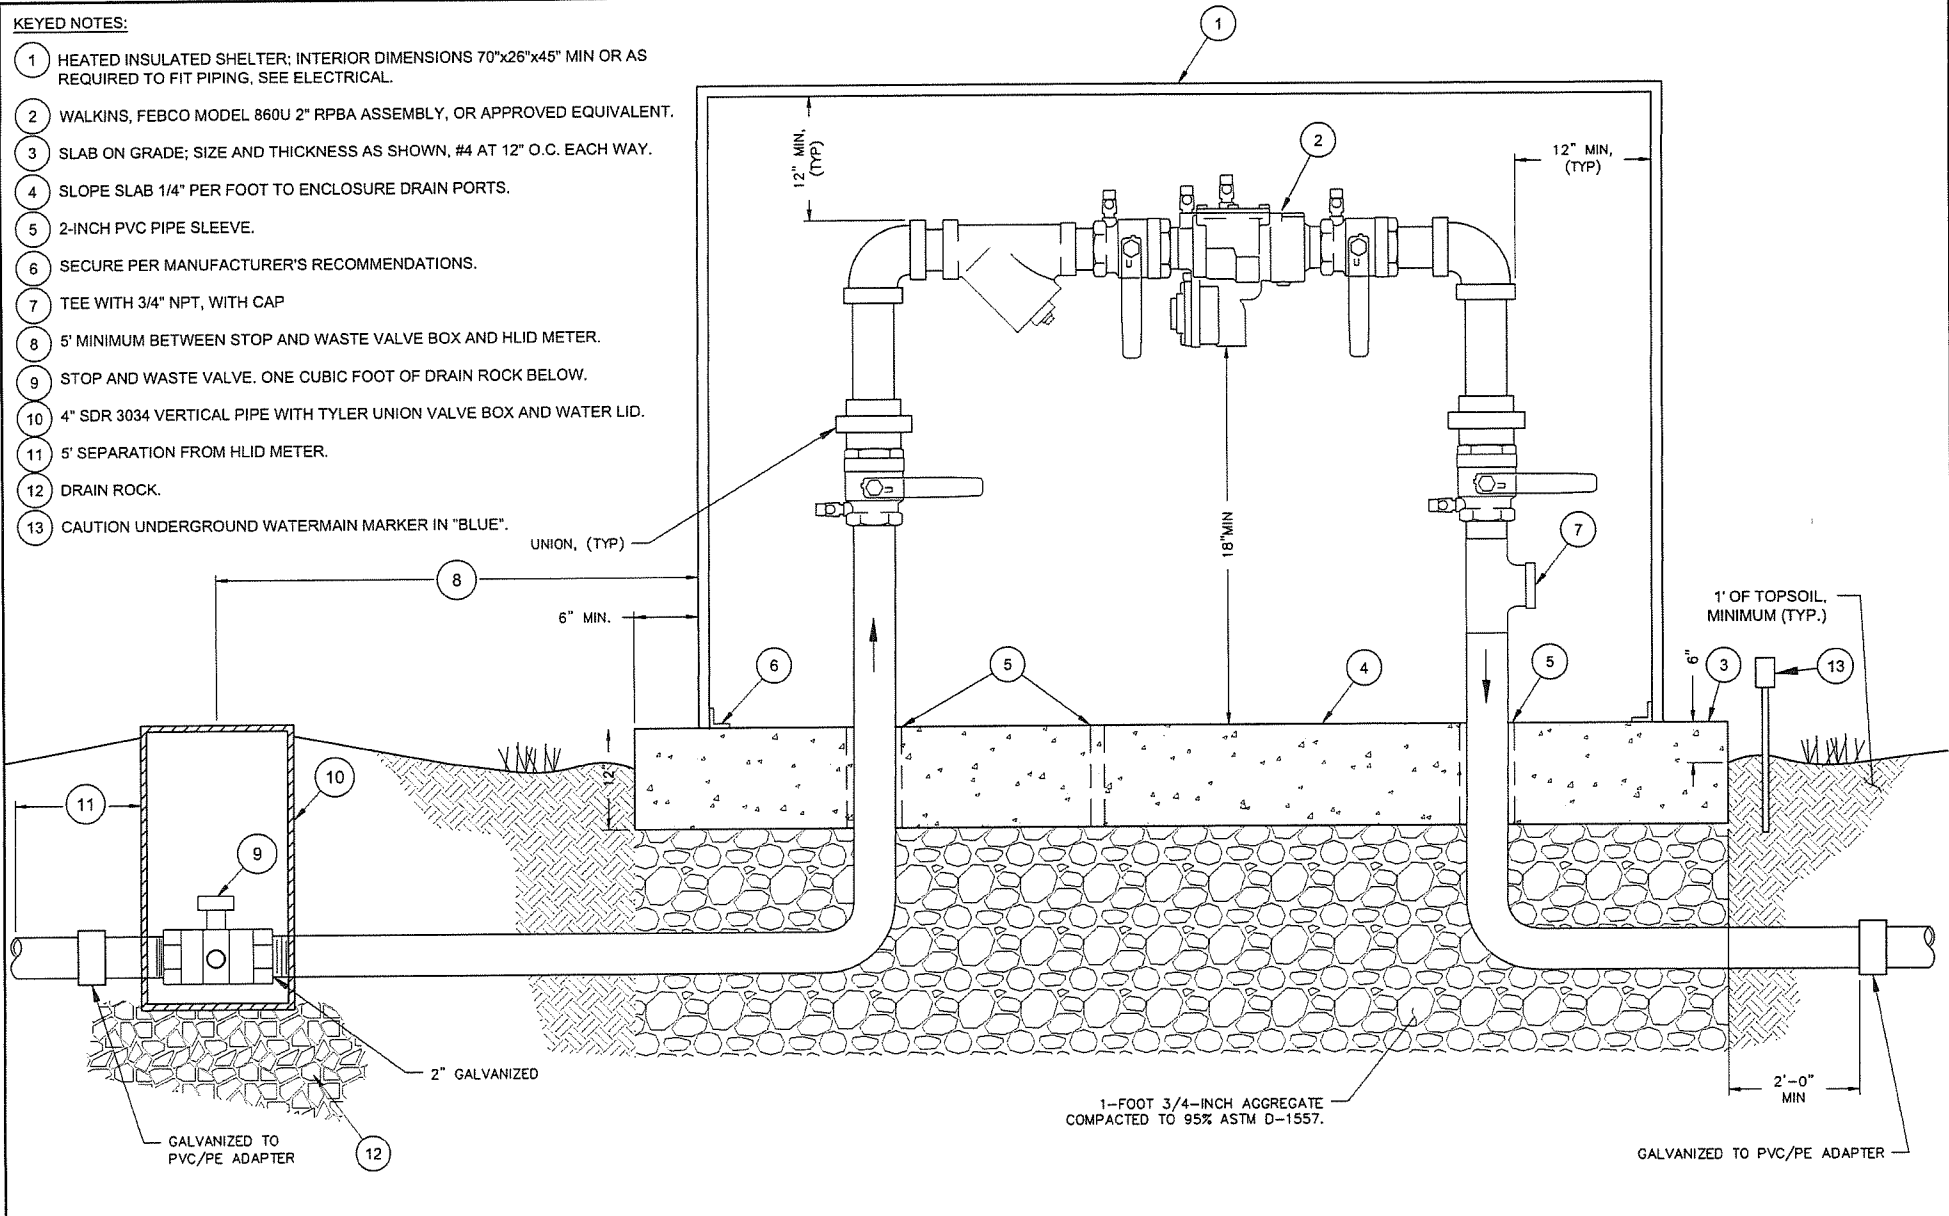

REVISIONS	
DATE	DESCRIPTION



**HAYDEN LAKE  
IRRIGATION DISTRICT**

**REDUCED PRESSURE BACKFLOW PREVENTER**

HLID DETAIL #:  
**009**

SCALE: NONE	DATE: July, 2022
DWG: 009 - RPBA (11-2019).dwg	APPROVED: BR